



Revista Ambiente & Água

ISSN: 1980-993X

Instituto de Pesquisas Ambientais em Bacias Hidrográficas

García-Ávila, Fernando; Ramos-Fernández, Lía; Zhindón-Arévalo, César
Estimation of corrosive and scaling trend in drinking water systems in the city of Azogues, Ecuador
Revista Ambiente & Água, vol. 13, no. 5, 2018
Instituto de Pesquisas Ambientais em Bacias Hidrográficas

DOI: 10.4136/ambi-agua.2237

Available in: <http://www.redalyc.org/articulo.oa?id=92860438005>

- How to cite
- Complete issue
- More information about this article
- Journal's homepage in redalyc.org

UAEM redalyc.org

Scientific Information System Redalyc

Network of Scientific Journals from Latin America and the Caribbean, Spain and Portugal

Project academic non-profit, developed under the open access initiative



Estimation of corrosive and scaling trend in drinking water systems in the city of Azogues, Ecuador

ARTICLES doi:10.4136/ambi-agua.2237

Received: 05 Feb. 2018; Accepted: 20 Aug. 2018

Fernando García-Ávila^{1,2*}; Lía Ramos-Fernández³; César Zhindón-Arévalo⁴

¹Universidad de Cuenca, Cuenca, Ecuador

Facultad de Ciencias Químicas. E-mail: garcia10f@hotmail.com

²Universidad Nacional Agraria La Molina, La Molina, Lima, Peru

E-mail: garcia10f@hotmail.com

³Universidad Nacional Agraria La Molina, La Molina, Lima, Peru

Departamento Académico de Recursos Hídricos. E-mail: liaseptiembre2012@hotmail.es

⁴Universidad Católica de Cuenca, Azogues, Ecuador

Unidad Académica de Salud y Bienestar. E-mail: cezhindona@ucacue.edu.ec

*Corresponding author

ABSTRACT

The quality of drinking water flowing in a distribution network can possess corrosive characteristics that may cause the material degradation of pipes and accessories. This problem can result in reduction of the service life of pipes and create a major public health problem. The agreement between the physical-chemical water quality analysis and national standards are not enough to confirm the balance of the water quality in terms of corrosion. In order to predict pipe corrosion in water distribution system networks, the corrosive trend was evaluated using the Langelier (LSI), Ryznar (RSI), and Larson-Skold (LRI) indexes based on measurements of pH, temperature, total dissolved solids, alkalinity, calcium hardness, sulfate and chloride. This study was setup with 180 samples collected in six zones of the distribution network, from July to December of 2017, according to the standard methods for the analysis of drinking water. The results indicate a variation of the LSI from -1.22 to -1.68; RSI from 9.75 to 10.52 and LRI from 0.46 to 0.77. A linear model was fitted for each index to predict the corrosion with the water quality conditions of this study case. Therefore, the drinking water of the city of Azogues, Ecuador has a corrosive tendency from significant to severe. Corrosion indices were calculated to provide useful information on the water's corrosiveness. These results indicate the need to constantly monitor the corrosion rate in the distribution network and conduct a laboratory study to adjust effective parameters such as pH, in order to control corrosion.

Keywords: Azogues city, corrosion rates, potabilization, water quality.

Estimativa da tendência corrosiva e de escala no sistema de água potável

RESUMO

A qualidade da água potável que flui em uma rede de distribuição pode fornecer características corrosivas que podem causar a degradação do material de tubos e acessórios. Esse problema pode resultar na redução da vida útil dos tubos e em um grande problema de



saúde pública. O acordo entre a análise físico-química da qualidade da água e os padrões nacionais não são suficientes para confirmar o equilíbrio da qualidade da água em termos de corrosão. Para prever a corrosão da tubulação nas redes do sistema de distribuição de água, a tendência corrosiva foi avaliada utilizando os índices Langelier (LSI), Ryznar (RSI) e Larson-Skold (LRI) com base em medidas de pH, temperatura, sólidos dissolvidos totais, alcalinidade, dureza de cálcio, sulfato e cloreto. Este estudo foi montado com 180 amostras coletadas em seis zonas da rede de distribuição, de julho a dezembro de 2017, de acordo com os métodos padronizados de análise de água potável. Os resultados obtidos indicam uma variação do LSI de -1,22 para -1,68; RSI de 9,75 a 10,52 e LRI de 0,46 a 0,77. Um modelo linear foi montado para cada índice para prever a corrosão com as condições de qualidade da água do presente estudo. Portanto, a água potável da cidade de Azogues (Equador) tem uma tendência corrosiva de significativa a severa. Os índices de corrosão foram calculados para fornecer informações úteis sobre a corrosividade da água. Esses resultados indicam a necessidade de monitorar constantemente a taxa de corrosão na rede de distribuição e realizar um estudo de laboratório para ajustar parâmetros efetivos como o pH, a fim de controlar a corrosão.

Palavras-chave: cidade de Azogues, potabilização, qualidade da água, taxas de corrosão.

1. INTRODUCTION

Guaranteeing the availability and sustainable management of drinking water in compliance with regulatory requirements will increase consumer confidence (Omaka et al., 2015; Sorlini et al., 2017; Collivignarelli, 2017). Drinking water causes corrosion in the pipes used for transport (Gholizadeh et al., 2017). Iron pipes that undergo a corrosion process could have a great impact on the water quality distributed in the supply network (Yang et al., 2012). The corrosion process in the pipes is related to several factors, such as the pipe material, water quality and hydraulic conditions (García-Avila et al., 2018). The effect of the different water quality parameters including pH, residual chlorine, total organic carbon, conductivity, dissolved oxygen, hardness and alkalinity influences corrosion and the formation of scale inside the metallic pipe (Cui et al., 2016). Vazdirvanidis et al. (2016) noted that the accelerated corrosion of parts of a water pump was probably caused by the presence of sulfates, sulfides and chlorides that caused a severe chemical attack on the various metallic components of the pump. Drinking water is commonly corrosive at a pH of 6.5 to 7.5 and with a low alkalinity. The corrosion potential of iron is affected by sulfate and chloride concentrations, which is why, as a consequence, chemical and physical differences are considered to alter water stability (Jazdzewska et al., 2016). Bigoni et al. (2014) indicated that the turbidity and iron concentration increase the corrosion of the pipes in the drinking water distribution network in a rural hospital in Peru. Corrosion of pipes and fittings that transport potable water is becoming a problem due to the high costs of repair and replacement (Liu et al., 2017). This means that it is important to know the physical and chemical characteristics of drinking water to determine the probable existence of corrosion using the Langelier saturation index (LSI), Ryznar stability index (RSI), the Larson-Skold index (LRI) (Achari et al., 2017).

Based on the LSI, 71% of the waters of the city of Shiraz, Iran is causing incrustation. Based on the RSI, all the zones lacked the characteristic of formation of incrustations' According to the LRI, 29% of the city have formations of inlays (Tavanpour et al., 2016). Considering the economic cost and the health risks related to incrustation and corrosion; the corrosive or fouling tendency can be analyzed using the indirect methods shown in Table 1. The equations of this table have been used to calculate the LSI (Liang et al., 2013; Alsaqqar et al., 2014; Choi et al., 2015; Vazdirvanidis et al., 2016; Gholizadeh et al., 2017); the RSI (Alsaqqar et al., 2014; Vazdirvanidis et al., 2016; Achari et al., 2017); and the LRI (Mirzabeygi

et al., 2017; Peng et al., 2013; Alsaqqar et al., 2014; Zhang et al., 2014).

Taking into account the corrosion problems caused in drinking water pipes and the lack of studies on the drinking water distribution network of the city of Azogues, Ecuador, this research was carried out to determine the corrosion/incrustations in the pipes of the different zones. The results provided information on the chemical behavior of inorganic contaminants in water and its influence on drinking water quality.

2. MATERIALS AND METHODS

2.1. Description of the study area

The drinking water distribution network on which this study was conducted is located in the city of Azogues, which is located in the southern part of the Ecuadorian Republic. Its geographical coordinates are: latitude $2^{\circ}44'22''$ S, longitude: $78^{\circ}50'54''$, and cover approximately 1200 km². The average altitude of the town is 2518 meters above sea level. The city has a population of 70,064 inhabitants. Its average temperature is 17°C; about 42,071 inhabitants receive water from the public network. There are no relevant studies on the corrosion that water can cause in the pipes and fittings of both the public and private networks. Figure 1 shows the location of the network supply, which is made up of pipes with diameters between 315 and 32 mm. The total length of the supply line is 218,105 m. A number of 288 valves have been installed. there are 26 reserves, distributed in six zones. Ten of the reserves have a capacity between 250 and 1000 m³. The altimetric variation of whole network is 2390-2823 meters above sea level.

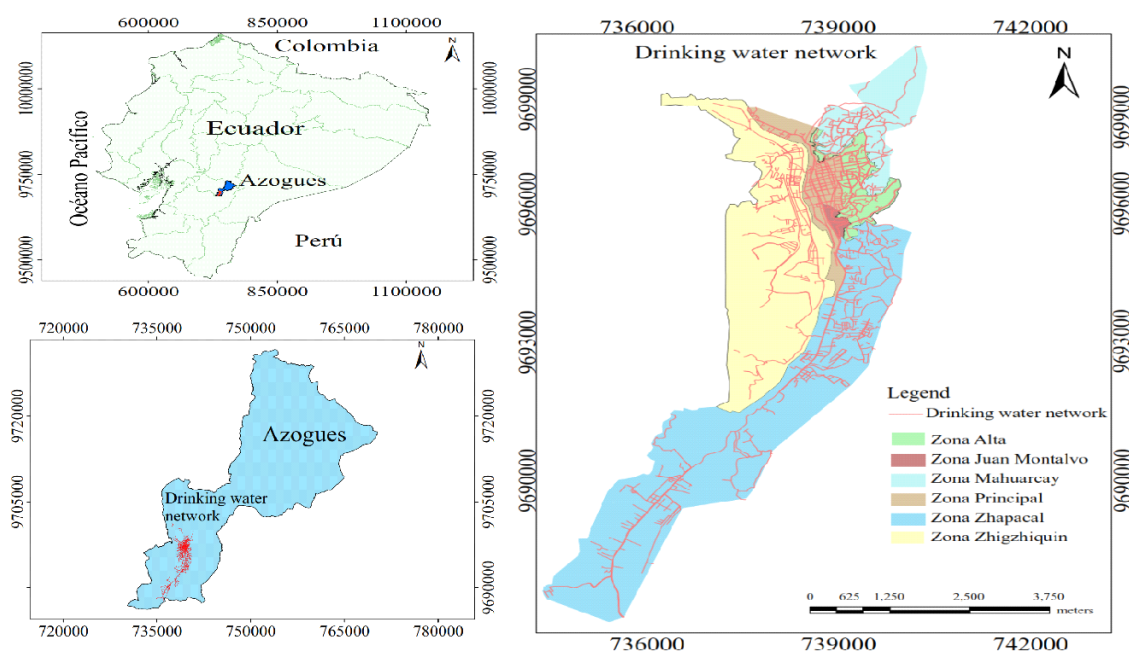


Figure 1. Location of the study area.

2.2. Sampling and analysis of water

To examine the conditions of corrosion and scale formation in the water distribution network of Azogues, 30 samples were taken monthly. A total of 180 drinking water samples were taken over six months at 30 sampling points; the sampling points were located in the drinking water distribution network taking into account the length of the distribution network, the location of the reserve tanks and the number of users present in each of the six zones. The sampling and analyses were carried out from July to December. All the samples were collected in polyethylene 1-liter containers complying with the necessary requirements to not alter the

samples for later analysis. The samples were obtained from the faucets in kitchens and bathrooms of homes, commercial places such as restaurants, workshops, washing cars, shops, etc., as well as from distribution tanks. The samples were maintained at 4°C and were transported on the same day for analysis to the laboratory of the city's municipal drinking water company. The tests on all water samples were analyzed according to the Standard Methods for the examination of water and wastewater (Apha et al., 2012). The calcium hardness and alkalinity were measured by the titration method; the concentration of hydrogen ions (pH), total dissolved solids (TDS) and temperature were measured with the Hach Multiparameter HQ 40d; chloride and sulfate were determined with the HACH DR 2500 Spectrophotometer and compared with national standards. The pH, TDS and temperature were determined in site.

2.3. Determination of corrosion and scaling trend in drinking water

The LSI, RSI and LRI were calculated using the corresponding equations in Table 1. These indices allow the evaluation of the corrosion potential of the pipeline for each point of the network once the physical-chemical analysis has been realized (Bigoni et al., 2014).

Table 1. Description of corrosion indexes used in this study.

Index	Equation	Value	Water Feature
LSI	LSI = pH-pH _s	LSI > 0	Scale forming
	LSI = Langelier Saturation Index	LSI = 0	Neutral
	pH = pH measured in situ.	LSI < 0	Corrosive
	pH _s = pH at saturation		
	pH _s = 9.3 + A + B - C - D		
RSI	Where:		
	$A = \frac{(\log_{10} TDS - 1)}{10}$	-0.4 to +0.4 is considered as a "zero"	
	B = [-13.12 log ₁₀ (273°C + T)] + 34.55		
	C = log ₁₀ [Ca ⁺² mg L ⁻¹ as CaCO ₃]-0.4		
	D = log ₁₀ [Alcal. mg L ⁻¹ L as CaCO ₃]		
RSI	TDS = Total Dissolved Solids (mg L ⁻¹)		
		RSI < 5.5	Heavy scale likely to form
	RSI = 2 pH _s -pH	5.5 < RSI < 6.2	Moderate scale-forming
	RSI = Ryznar Stability Index	6.2 < RSI < 6.8	Is considered neutral
	pH _s = pH at saturation	6.8 < RSI < 8	Low corrosion
LRI	pH = pH measured in situ.	RSI > 8	High corrosion
		LRI < 0.8	Chloride and sulfate are unlikely to interfere with the formation of protecting film
	$LRI = \frac{[(Cl^-) + (SO_4^{2-})]}{[(HCO_3^-) + (CO_3^{2-})]}$	0.8 < LRI < 1.2	Corrosion rates may be higher than expected
		LRI > 1.2	High rates of localized corrosion may be expected.

Source: Alsaqqar et al. (2014); Tavanpour et al. (2016); Mirzabeygi et al. (2017).

3. RESULTS AND DISCUSSION

3.1. Physical and chemical characteristics

Table 2 shows the average values of temperature, pH, total dissolved solids (TDS), the calcium hardness, alkalinity, chlorides, sulfates and free chlorine of the 180 samples collected at the 30 sites monitored over six months. Figure 2 shows the variation of the physical-chemical parameters of drinking water obtained at each of the sampling points.

When analyzing the pH values of both Table 2 and Figure 2, conditions observed are almost neutral at each sampling point and during all the months analyzed. In terms of quality of drinking water according to the Ecuadorian standard, the recommended established value is a minimum pH of 6.5 and a maximum of 8.5. While the waters evaluated are within the acceptable range with values between 6.87 and 7.75, certain samples presented a pH less than 7 and were taken in the month of July. This slightly acidic condition can accelerate corrosive processes; this pH record is due to a contribution from natural processes. For its part, the temperature of water presented values near the ambient temperature for all samples; the temperature varied between 12.4 and 24.8°C. The low temperatures that mostly correspond to the months of July, August and September indicate that there is a tendency to corrosion; there are no high temperatures that may cause the precipitation of calcium carbonate, which can cause scale in the pipes and therefore decrease the corrosion. Considering the average values of Figure 2, it can be observed that the temperature values varies according the month, so the lowest temperatures are presented in the months of July and August, while the highest temperatures are presented in the months of October, November and December.

To determine the corrosive or scaling character of the water, it is also important to know the concentration of total dissolved solids (TDS). This parameter in the first instance provides an indicator of the quality of drinking water. Hence, when compared to the maximum permissible value of the Ecuadorian standard equivalent to 1000 mg L⁻¹, it can be observed that the water distributed in Azogues presents values between 43.1 and 108.0 mg L⁻¹, well below the established maximums. Even in spite of the low concentrations of TDS, it is important to note that the concentration of total dissolved solids in aqueous solutions is directly proportional to the conductivity, and its increase can favor the corrosive tendency.

When examining the values of drinking water hardness presented in Figure 2, according to the classification, it is observed that this water presents slightly hard values, which is especially related to low concentrations of calcium. This parameter is also an indicator of the quality of drinking water. Hence, when compared with the maximum permissible value of the Ecuadorian standard equivalent to 300 mg L⁻¹, it can be observed that drinking water for the present study has values between 32.1 and 79.1 mg L⁻¹, which are well below the established maximums. Waters with low hardness are considered aggressive, causing deterioration and corrosion in supply networks. This fact, together with the low pH presented at certain points, can generate a corrosive effect on the part of these waters.

Figure 2 shows that the alkalinity during the months of July to September has lower values compared to the months of October to December. This is due to the fact that during the months of July and August there are generally fewer rains that cause a decrease in alkalinity; in general there is a corrosive tendency caused by low alkalinity of water, which is at values lower than 76 mg L⁻¹ as calcium carbonate. The Ecuadorian norm for concentrations of sulfate and chloride ions in drinking water establish maximum permissible values of 200 mg L⁻¹, 250 mg L⁻¹, respectively. The average values found in the drinking water in the present study were 5.65 mg L⁻¹ and 18.12 mg L⁻¹, which are well below the established norm. Sulfate ions and chlorides are components of natural waters, which is why the presence of these ions and their low concentrations is justified.

Table 2. Average values of the analysis of water collected in the sampling sites.

N° Sample	pH	Temperature °C	TDS mg L ⁻¹	Calcium mg L ⁻¹ as CaCO ₃	Alkalinity mg L ⁻¹ as CaCO ₃	Sulphate mg L ⁻¹	Chloride mg L ⁻¹
1	7.42 ± 0.07	17.66 ± 0.6	81.17 ± 7.02	20.40 ± 1.91	46.83 ± 6.30	22.33 ± 2.73	5.30 ± 0.47
2	7.38 ± 0.08	18.96 ± 0.4	82.17 ± 5.33	20.87 ± 1.49	50.00 ± 6.32	21.00 ± 2.45	5.58 ± 0.55
3	7.2 ± 0.06	16.72 ± 1.0	63.67 ± 4.54	20.87 ± 2.01	51.33 ± 5.33	19.17 ± 1.96	5.33 ± 0.59
4	7.17 ± 0.05	19.44 ± 0.7	80.67 ± 7.82	23.13 ± 1.79	48.67 ± 5.81	23.00 ± 2.27	5.22 ± 0.54
5	7.41 ± 0.12	18.02 ± 0.5	71.50 ± 6.48	21.80 ± 2.80	46.67 ± 6.27	19.50 ± 2.91	5.05 ± 0.96
6	7.23 ± 0.07	17.3 ± 0.6	70.50 ± 5.16	22.47 ± 1.54	52.50 ± 5.90	19.17 ± 2.01	5.12 ± 0.57
7	7.2 ± 0.06	17.44 ± 0.8	72.33 ± 6.01	21.67 ± 2.01	52.5 ± 6.05	18.83 ± 2.06	11.58 ± 0.6
8	7.18 ± 0.06	16.3 ± 0.6	72.33 ± 4.24	21.73 ± 1.79	53.67 ± 5.65	18.58 ± 1.70	4.57 ± 1.05
9	7.2 ± 0.05	17.72 ± 1.0	64.50 ± 5.91	21.00 ± 1.43	49.50 ± 5.14	17.33 ± 2.33	5.38 ± 0.71
10	7.22 ± 0.05	16.1 ± 1.4	66.33 ± 4.76	20.20 ± 1.63	50.50 ± 6.04	17.33 ± 1.96	5.70 ± 0.48
11	7.16 ± 0.05	15.78 ± 0.3	72.67 ± 6.50	21.33 ± 1.66	51.00 ± 4.92	15.50 ± 2.08	5.58 ± 0.97
12	7.26 ± 0.05	15.66 ± 0.8	68.83 ± 4.69	21.47 ± 1.14	53.67 ± 6.06	17.00 ± 2.77	4.95 ± 0.6
13	7.11 ± 0.08	16.16 ± 1.2	60.00 ± 3.66	17.47 ± 0.98	40.67 ± 2.53	13.50 ± 2.77	7.27 ± 1.56
14	7.25 ± 0.10	18.06 ± 0.8	70.00 ± 5.66	22.23 ± 2.16	47.00 ± 6.47	21.00 ± 2.39	5.30 ± 0.41
15	7.3 ± 0.08	16.36 ± 0.4	70.33 ± 6.54	21.57 ± 1.48	48.67 ± 4.98	20.17 ± 1.66	5.67 ± 0.46
16	7.17 ± 0.06	18.2 ± 1.3	72.67 ± 7.29	21.33 ± 1.35	45.67 ± 4.90	21.17 ± 2.24	5.22 ± 0.4
17	7.21 ± 0.07	17.64 ± 0.2	69.83 ± 5.55	20.60 ± 1.39	46.00 ± 4.50	18.83 ± 1.89	5.62 ± 0.74
18	7.24 ± 0.06	17.8 ± 0.7	68.67 ± 6.99	22.00 ± 1.78	48.83 ± 5.08	19.00 ± 2.82	5.58 ± 0.4
19	7.23 ± 0.09	17.76 ± 0.6	71.00 ± 6.04	21.87 ± 1.90	47.50 ± 5.66	19.67 ± 2.38	5.58 ± 0.65
20	7.18 ± 0.06	17.52 ± 1.2	69.67 ± 7.22	21.20 ± 1.48	46.52 ± 4.27	17.67 ± 2.69	5.57 ± 0.61
21	7.22 ± 0.06	18.7 ± 0.4	58.17 ± 2.33	17.47 ± 1.0	40.82 ± 1.87	12.50 ± 2.79	6.63 ± 1.03
22	7.24 ± 0.04	17.3 ± 0.5	63.50 ± 4.92	20.13 ± 1.54	46.50 ± 4.15	18.50 ± 2.17	5.72 ± 0.80
23	7.24 ± 0.09	17.62 ± 0.7	68.17 ± 5.13	21.33 ± 1.78	49.17 ± 5.24	19.50 ± 2.11	5.47 ± 0.47
24	7.26 ± 0.07	17.22 ± 1.1	66.83 ± 6.77	21.07 ± 1.73	47.50 ± 2.96	17.50 ± 2.62	5.80 ± 0.58
25	7.2 ± 0.05	17.1 ± 0.7	64.33 ± 3.8	20.07 ± 1.56	46.33 ± 3.48	17.00 ± 2.28	5.30 ± 0.82
26	7.26 ± 0.09	18.1 ± 0.6	67.83 ± 5.15	20.67 ± 1.37	48.83 ± 4.43	16.33 ± 2.33	5.88 ± 0.74
27	7.28 ± 0.07	16.24 ± 1.1	65.17 ± 6.99	20.13 ± 1.54	47.67 ± 4.72	15.83 ± 2.21	6.03 ± 0.68
28	7.31 ± 0.06	17.16 ± 1.2	67.83 ± 5.70	20.2 ± 1.51	51.33 ± 4.72	17.33 ± 2.17	6.00 ± 0.86
29	7.26 ± 0.05	18.56 ± 0.8	72.50 ± 6.84	20.13 ± 1.43	49.00 ± 5.49	16.17 ± 2.70	5.93 ± 0.67
30	7.27 ± 0.06	17.26 ± 1.2	59.83 ± 2.64	17.33 ± 0.91	40.00 ± 2.54	14.00 ± 3.2	5.97 ± 1.22

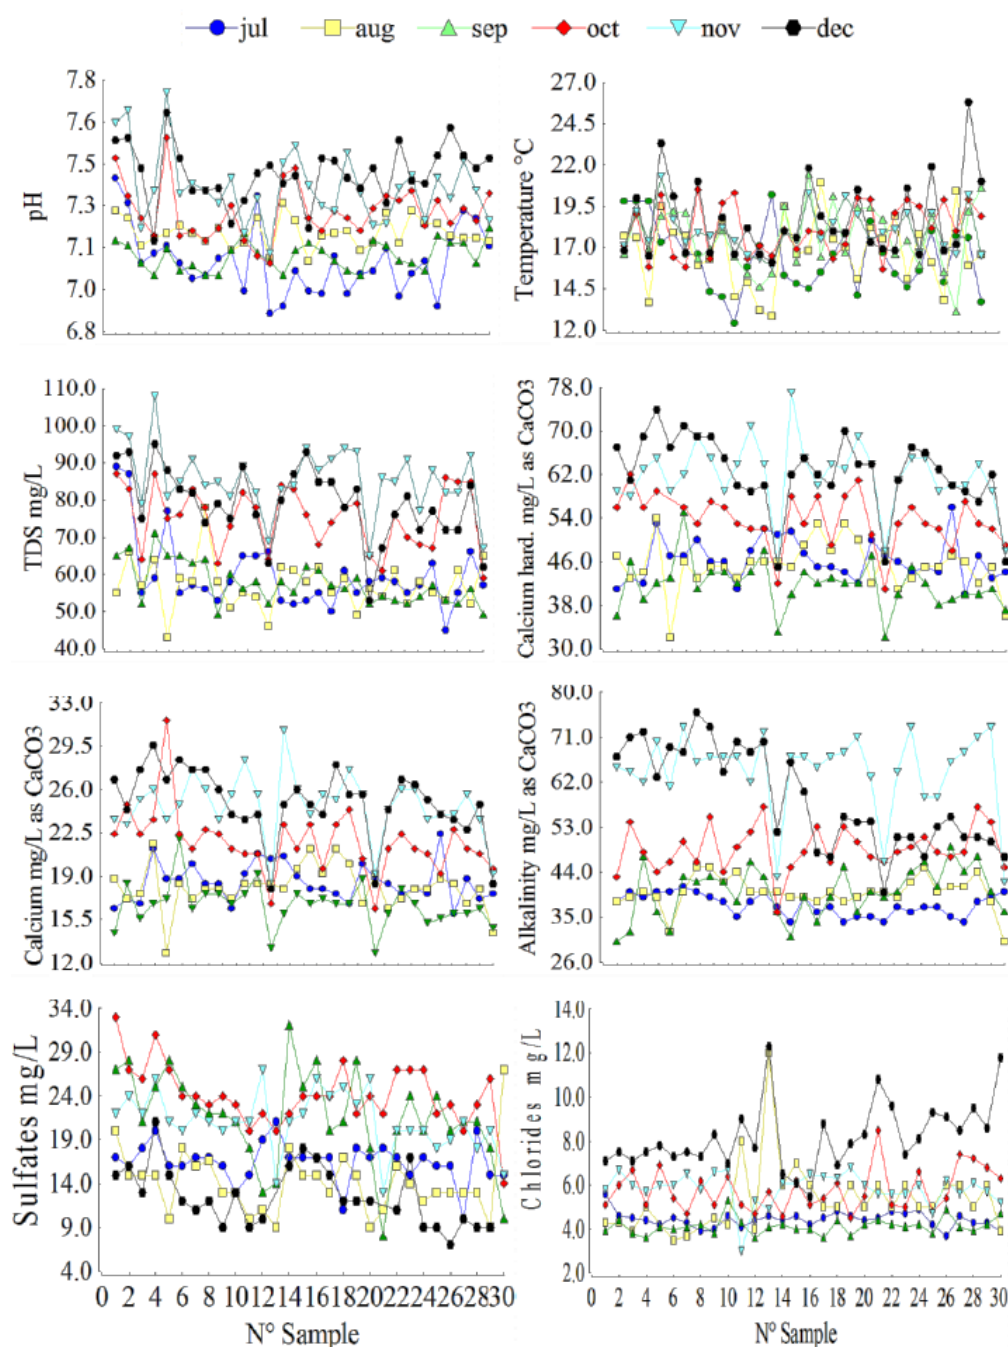


Figure 2. Variation of pH, temperature, TDS, calcium, alkalinity, sulfates and chlorides of drinking water in the distribution network sampling points.

3.2. Corrosion monitoring

Table 3 presents the mean values of the indices obtained by zones of the supply network. The table shows that the values of the indices are similar in each of the zones. All values obtained for the LSI are negative, with an average value of 1.39 (Table 3 and Figure 3), indicating that the water that is distributed in all zones of Azogues is corrosive, considering that at more negative values there is greater corrosivity. The values in Table 3 show that the zones Zhigzhiquin and Zhapacal (2390-2500 altitude meters above sea level) have less negative values with respect to the Mahuarcay zone (altitude 2700-2823 meters above sea level); this could be due to the temperature variation, which in turn affects the pH.

The values obtained with the RSI turned out to be greater than nine, indicating that the water that is distributed in Azogues is very corrosive. It can be seen that the LRI average value

of 10.07 shows a slightly to moderately corrosive character of the drinking water distributed in Azogues. Meanwhile, average LRI values of 0.58 were obtained, which does not conform with the strongly corrosive character determined by the Langelier and Ryznar models. This difference is because the Larson-Skold relationship is based on the corrosive influence of the chloride, sulfate and bicarbonate ion, not considering other physicochemical factors such as pH, temperature, total dissolved solids, alkalinity and calcium.

Table 3. Average values of corrosion indexes by zones.

Zone	LSI	RSI	LRI
Alta	-1.40	10.03	0.52
Mahuarcay	-1.58	10.38	0.53
Media	-1.4	10.03	0.67
Zhigzhiquin	-1.31	9.94	0.63
Principal	-1.43	10.09	0.54
Zhapacal	-1.34	9.93	0.60
Average	-1.39	10.07	0.58
p	<0.0001	<0.0001	<0.0001

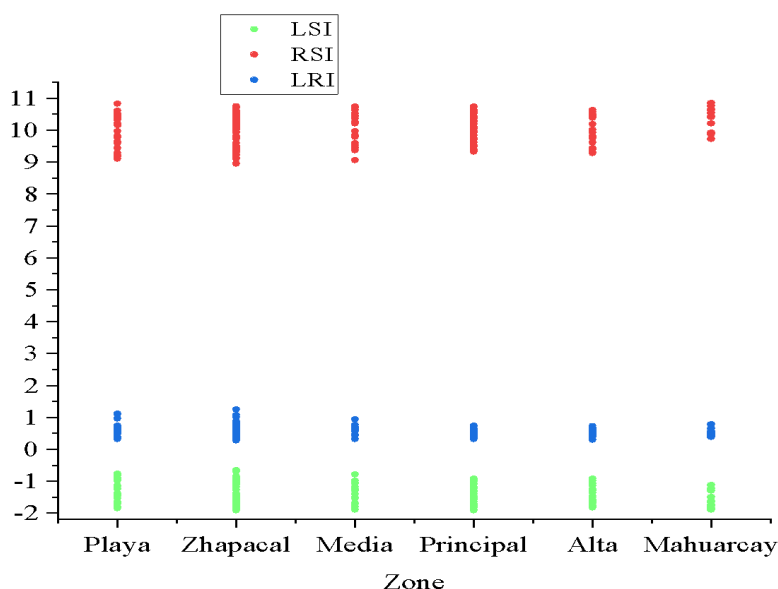


Figure 3. Variation of corrosion indexes in the different zones.

The results obtained by several authors are presented in Table 4. When compared with the results obtained in this study, we can observe a similarity to the results obtained by Alimoradi et al. (2018) and Khorsandi et al. (2015). These waters are highly corrosive based on the LSI, RSI and LRI; but they have no tendency to form coatings of calcium carbonate precipitates, due to the low alkalinity and hardness.

Table 4. Average values of LSI, RSI, LRI obtained by several authors.

Authors	LSI	RSI	LRI
Abbasnia et al. (2018)	0.5	6.76	2.71
Yousefi et al. (2018)	1.15	6.92	0.85
Alimoradi et al. (2018)	-1.31	9.73	0.24
Khorsandi et al. (2015)	-1.94	12.05	0.68
Tavanpour et al. (2016)	0.08	7.15	1.1

Figure 4 shows the variation of corrosion indexes with physical-chemical parameters. pH is one of the main factors that influence the corrosion process (Cui et al., 2016). In Table 2 and Figure 2, it can be observed that the pH varied between 6.87 and 7.75, with an average of 7.24. In Figure 4(a) it can be seen that the LSI increases with increasing pH; meanwhile, the RSI decreased with the increase of pH. Therefore, corrosion increases with the decrease in pH. Another factor that alters the corrosion process is temperature; increase in temperature can cause the precipitation of calcium carbonate, which can cause encrustation in the pipes and therefore reduce corrosion. In Table 2 and Figure 2, it can be observed that the temperature varied between 12.4 and 24.8°C, with an average of 17.6°C. In Figure 4(b), it can be seen that the LSI increased with the temperature increase; meanwhile, the RSI decreased with temperature.

The conventional potabilization process does not affect the dissolved content of treated water. The effect of TDS content on the corrosivity of water is a complex issue; some substances such as carbonate and bicarbonate reduce corrosion, while chloride and sulfate ions notably accelerate corrosion (Alsaqqar et al., 2014). From the data registered in Table 2 and Figure 2, the TDS concentration fluctuated between 43.1 and 108.0 mg L⁻¹ with an average of 69.29 mg L⁻¹. In Figure 4(c) it can be seen that the LSI increased with the increase of the TDS. Meanwhile, the RSI was reduced with the increase of TDS; therefore the corrosion increases with the decrease of TDS. Calcium is the second most frequent component in most surface waters and is generally among the three or four most frequent ions in groundwater. The increase Ca²⁺ concentration decreases water corrosivity (Mirzabeygi et al., 2017), since Ca²⁺ is important for the formation of a passivation film on the surface of the pipe, decreasing corrosion. From the data recorded in Table 2 and Figure 2, the Ca²⁺ concentration varied between 12.8 and 31.6 mg L⁻¹, with an average of 20.8 mg L⁻¹. In Figure 4(d), it can be seen that the LSI increased with the calcium increase; the RSI decreased with the calcium increase. The slightly low calcium values in this study influenced the presence of drinking water corrosion.

In water treatment plants, alkalinity is required in the coagulation process for the reaction of alum with water; lime can be added if natural alkalinity is not sufficient for this reaction. Water corrosivity increases as alkalinity decreases (Peng et al., 2013, Choi et al., 2015). According to data obtained from the water analysis, the variation in alkalinity ranged between 30.00 and 76.00 mg L⁻¹, with an average of 48.42 mg L⁻¹ as CaCO₃, as shown in Table 2 and Figure 2. In Figure 4(e) it can be seen that the LSI increased with the increase in alkalinity; meanwhile, the RSI decreased with the increase in alkalinity. The somewhat low concentrations of alkalinity that have been obtained in this study favor the solubility of CO₂, increasing the drinking water corrosivity; it can also be observed that alkalinity does not have a great relationship with the LRI.

The chloride and sulfate ions drastically reduce corrosion resistance (Vazdirvanidis et al., 2016; Yang et al., 2012). Steel is easily susceptible to pitting corrosion in solutions containing aerated chloride with pH in a wide range (4 - 12.5) at room temperature (Wang et al., 2015). According to data obtained from the water analysis, the chloride ion concentration fluctuated between 1.30 and 12.30 mg L⁻¹, with an average of 5.65 mg L⁻¹; the sulfate varied between 3.0 and 33.0 mg L⁻¹ with an average of 18.12 mg L⁻¹, as shown in Table 2 and Figure 2. In Figure 4(f), it can be seen that the LRI increases with the increase of the concentration of the sulfate ion; the LRI does not show a direct relationship with the chloride ion concentration. Hence, according to the LRI values obtained in this study, there is a slight corrosion of drinking water.

A box plot was made using the monthly results for each of the indices. For the LSI, Figure 5(a) shows that during the first three months of monitoring (July-September) values are observed between -1.40 and -2.00, indicating a strong corrosion. This is due to the fact that in these months the ambient temperature and therefore of the water is low with respect to that registered during the year. In the same way, the alkalinity and pH were slightly low from July

to September, which increased the corrosion. From October to December, a decrease of -1.40 to -0.80 can be observed in the LSI, generating a less corrosive tendency than during the three previous months.

Analyzing the box plot for the RSI, Figure 5(b) shows that during the first three months of sampling (July-September) values between 10.00 and 11.00 are observed, due to a significant decrease in terms of the temperature, pH and alkalinity. During the following three months a decrease in the index of 10.00 to 9.00 can be observed, decreasing this index, but retaining its severe corrosive character.

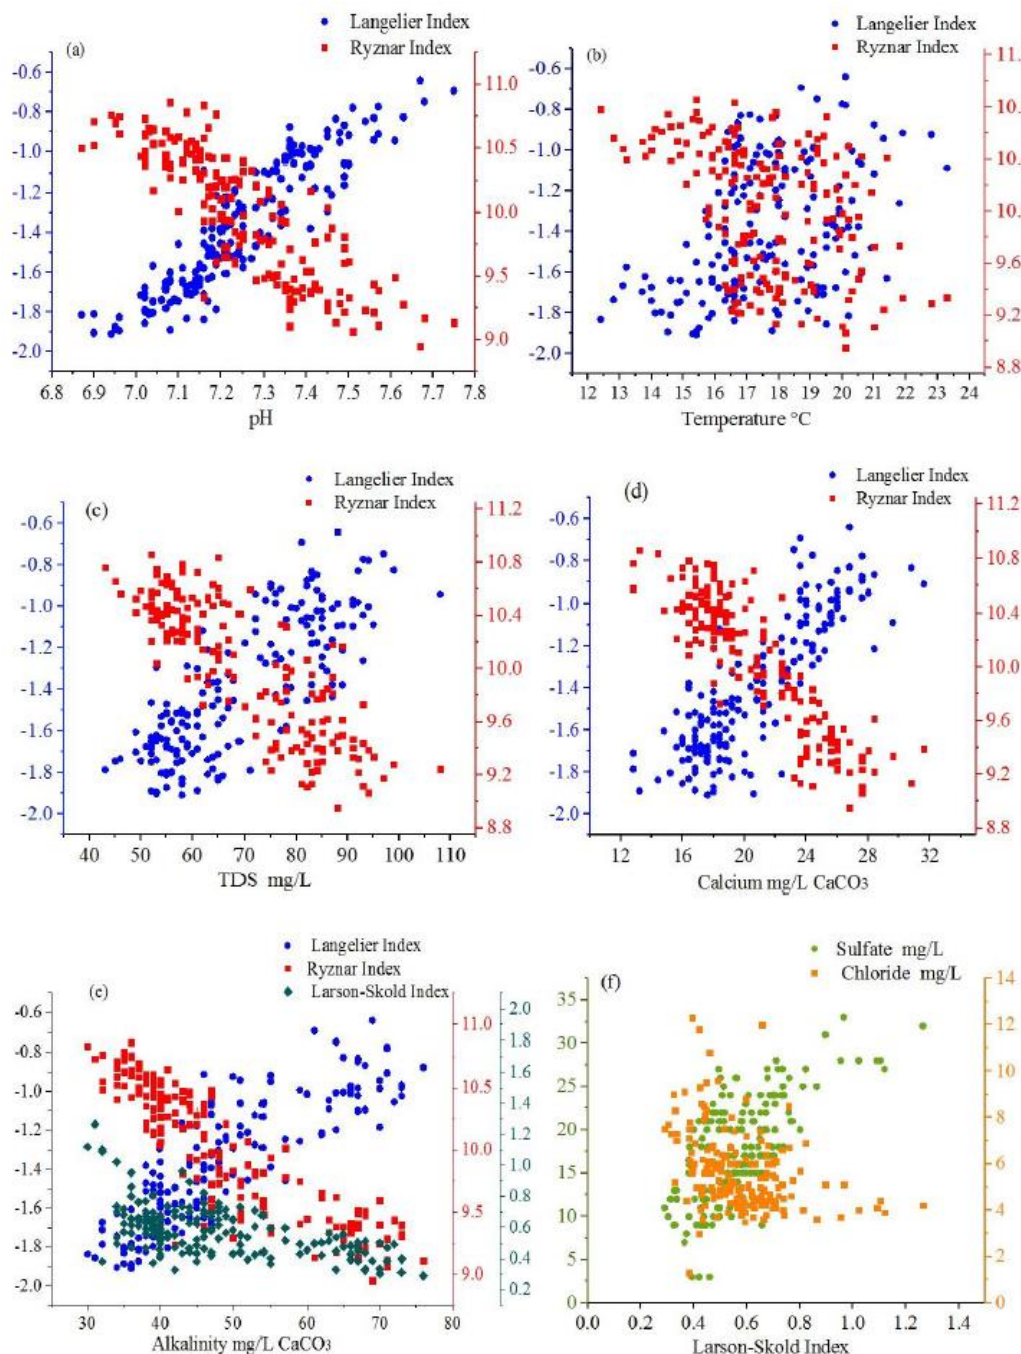


Figure 4. Variation of corrosion indexes with physical-chemical parameters. (a) pH relationship with LSI and RSI; (b) temperature relationship with LSI and RSI; (c) TDS relationship with LSI and RSI; (d) calcium relationship with LSI and RSI; (e) alkalinity relationship with LSI, RSI and LRI; (f) LRI relationship with sulfates and chlorides.

In Figure 5(c), we can observe a constant trend regarding the LRI; the values calculated and analyzed during July - December, are between the range of 0.29 to 1.26, with an average value of 0.56, presenting a slight corrosion, with a slightly corrosive character, which indicates that there is little amount of chloride and sulfate ions that can cause corrosivity.

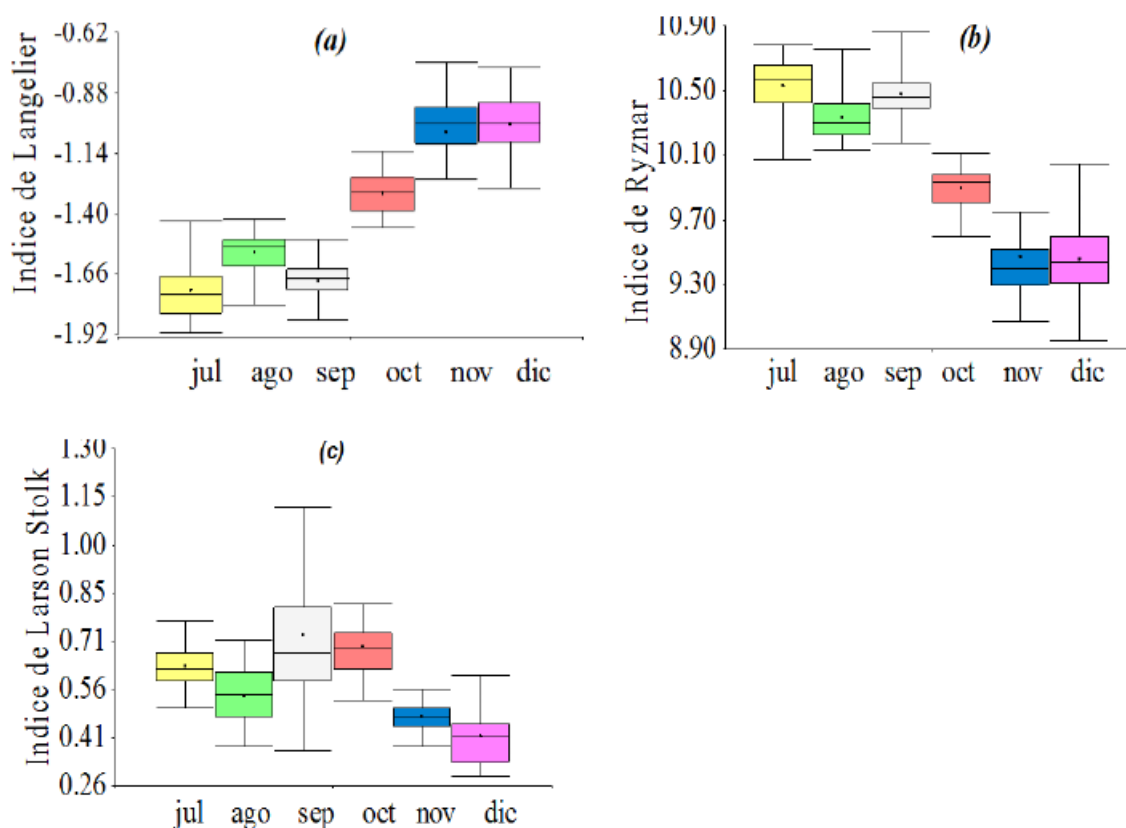


Figure 5. Variation of corrosion indexes over time. (a) Variation of LSI with months, (b) Variation of RSI with months, (c) Variation of LRI with months.

3.3. Linear model for corrosion indexes

To facilitate the calculation of corrosion in the drinking water distribution network in Azogues, a mathematical model was obtained for each of the corrosion indexes analyzed in this study. The multiple regression technique was applied using Infostat software, based on data of pH, temperature, SDT, alkalinity, calcium, sulfates and chlorides, obtained from drinking water sampling and analysis. The results of the multiple regression for LSI are presented in Table 5.

Table 5. Regression coefficients and statistical data associated with the LSI model.

Coef	Est.	E.E.	LI (95%)	LS (95%)	T	P-Value	CpMallows	VIF
Const	-9.84	0.06	-9.96	-9.71	-155.32	<0.0001		
PH	1.01	0.01	0.99	1.03	106.29	<0.0001	11236.03	1.96
T	0.02	6.60E-04	0.02	0.02	28.91	<0.0001	836.03	1.36
SDT	-4.30E-04	1.60E-04	-7.50E-04	-1.20E-04	-2.69	0.008	12.18	3.91
Calcium	0.02	5.50E-04	0.02	0.02	38.61	<0.0001	1487.2	3.42
Alkalinity	0.01	1.80E-04	0.01	0.01	44.71	<0.0001	1992.51	3.49

It can be observed that the pH, temperature, TDS, calcium and alkalinity showed a value $p < 0.05$, there being a significant linear relationship with the LSI. The model obtained for the LSI is (Equation 1):

$$LSI = -9.95 + 1.03pH + 0.02T - 0.00049SDT + 0.02 \text{ Calcium} + 0.01 \text{ Alkalinity} \quad (1)$$

The equation is useful to calculate the LSI knowing the values of pH, temperature in °C, SDT in mg/L, calcium hardness in and alkalinity in mg/L as CaCO₃.

The results of the multiple regression for RSI are presented in Table 6. It can also be noted that the pH, T, SDT, calcium and alkalinity showed a value $p < 0.05$, there being also a significant linear relationship with the RSI. The model obtained for the RSI is (Equation 2):

$$RSI = 19.93 - 1.06 pH - 0.04T + 0.00096 SDT - 0.04 Calcium - 0.02 Alkalinity \quad (2)$$

Table 6. Regression coefficients and statistical data associated with the RSI model.

Coef	Est.	E.E.	LI (95%)	LS (95%)	T	P-Value	CpMallovs	VIF
Const	19.7	0.12	13.67	19.95	157.76	<0.0001		
PH	-1.02	0.02	-1.06	-0.99	-54.61	<0.0001	2969.87	1.96
T	-0.04	1.30E-03	-0.04	-0.04	-29.55	<0.0001	873.33	1.36
SDT	8.40E-04	3.20E-04	2.10E-04	1.50E-03	2.64	0.0091	11.94	3.91
Calcium	-0.04	1.10E-03	-0.04	-0.04	-39.07	<0.0001	1522.9	3.42
Alkalinity	-0.02	3.60E-04	-0.02	-0.02	-45.06	<0.0001	2023.09	3.49

4. CONCLUSIONS

Although the temperature values, total dissolved solids, alkalinity, calcium hardness, sulfate and chloride obtained in this study were admissible based on Ecuadorian regulations, the average values of the corrosion indexes obtained in this study indicated a significant corrosive tendency. The results obtained were: LSI: -1.39; RSI: 10.02 and LRI: 0.58. These indicated a significant corrosive tendency of the drinking water distributed in Azogues. The most critical parameter analyzed for the LSI and RSI is pH, as well as the low alkalinity and low hardness; while, for the Larson-Stolk index, the most critical parameter is sulfate. It can be concluded that an understanding of the chemical composition of drinking water is vital for predicting the materials behavior that are in contact with drinking water. The corrosion calculation caused by the water is based solely on the physical chemical parameters proposed by Langelier, Ryznar and Larson-Skold; this is not so exact, considering other factors or conditions that prevail in a typical drinking water network, such as dissolved oxygen, residual chlorine and room temperature. the supply system. This factor should be taken into account for the control and prevention of corrosion potential; adjustments in stabilization should be made at the treatment plant.

5. ACKNOWLEDGEMENTS

Fernando García developed this project with his own funds during his doctoral studies in Engineering and Environmental Sciences. The authors thank Eng. Xavier Ramírez, the manager of EMAPAL EP, for his support of this study. We also thank Damián Pauta and Diego Quezada, who helped with the monitoring campaign described, and Lcda Lucy Timbe for his help in translating the document.

6. REFERENCES

- ABBASNIA, A.; ALIMOHAMMADI, M.; MAHVIA, A. H.; NABIZADEH, R.; YOUSEFI, M.; MOHAMMADI, A. A. et al. Assessment of groundwater quality and evaluation of scaling and corrosiveness potential of drinking water samples in villages of Chabahr city, Sistan and Baluchistan province in Iran. **Data Brief**, v. 16, p. 182-192, 2018. <https://doi.org/10.1016/j.dib.2017.11.003>

- ACHARI, V. S.; DEEPA, P.; AMBILI, M. S.; GEORGE, T. R. Corrosion Indices, Drinking and Irrigation Water Quality of Andhakaranazhy and Cherai Coastal Regions of Kerala. **Academy of Chemistry Teachers**, v. 3, n. 1, p. 10-14, 2017.
- ALIMORADI, J.; NAGHIPOUR, D.; KAMANI, H. Data on corrosive water in the sources and distribution network of drinking water in north of Iran. **Data Brief**, v.17, p.105-118, 2018. <https://doi.org/10.1016/j.dib.2017.12.057>
- ALSAQQAR, A.; KHUDAIR, B.; ALI, S. Evaluating Water Stability Indices from Water Treatment Plants in Baghdad City. **Journal of Water Resource and Protection**, v. 6, n. 14, p. 1344-1351, 2014. <http://dx.doi.org/10.4236/jwarp.2014.614124>
- AMERICAN PUBLIC HEALTH ASSOCIATION – APHA; AMERICAN WATER WORKS ASSOCIATION – AWWA; WATER ENVIRONMENT FEDERATION - WEF. **Standard Methods for examination of water and wastewater**. Washington, DC, 2012.
- BIGONI, R.; SORLINI, S.; COLLIVIGNARELLI, M. C.; BERBENNI, P. Drinking water quality assessment and corrosion mitigation in the hospital water supply system of Chacas village (Perú). **Revista Ambiente & Água**, v. 9, n. 3, p. 379-389, 2014. <http://dx.doi.org/10.4136/ambi-agua.1407>
- CHOI, J.; GYU, B.; HONG, S. Effects of NF treated water on corrosion of pipe distribution system and its implications to blending with conventionally treated water. **Desalination**, v. 360, p. 138-145, 2015. <https://doi.org/10.1016/j.desal.2015.01.026>
- COLLIVIGNARELLI, C. Water safety: one of the primary objectives of our time. **Revista Ambiente & Água**, v. 12, n. 1, p. 1-7, 2017. <http://dx.doi.org/10.4136/ambi-agua.1994>
- CUI, Y.; LIU, S.; SMITH, K.; YU, K.; HU, H.; JIANG, W. Characterization of corrosion scale formed on stainless steel delivery pipe for reclaimed water treatment. **Water Research**, v. 88, p. 816-825, 2016. <http://dx.doi.org/10.1016/j.watres.2015.11.021>
- GARCÍA-AVILA, F.; BONIFAZ-BARBA, G.; DONOSO-MOSCOSO, S.; FLORES DEL PINO, L.; RAMOS-FERNÁNDEZ, L. Dataset of copper pipes corrosion after exposure to chlorine. **Data Brief**, v. 19, p. 170-178, 2018. <https://doi.org/10.1016/j.dib.2018.05.023>
- GHOLIZADEH, A.; MOKHTARI, M.; NAIMI, N.; SHIRAVANDC, B.; EHRAMPOUSHA, M. H.; MIRI, M. et al. Assessment of corrosion and scaling potential in groundwater resources; a case study of Yazd-Ardakan Plain , Iran. **Groundwater for Sustainable Development**, v. 5, p. 59-65, 2017. <https://doi.org/10.1016/j.gsd.2017.04.002>
- JAZDZEWSKA, A.; DAROWICKI, K.; ORLIKOWSKI, J.; KRAKOWIAK, S.; ZAKOWSKI, K.; GRUSZKA, M. et al. Critical analysis of laboratory measurements and monitoring system of water-pipe network corrosion-case study. **Case Studies in Construction Materials**, v.4, p. 102-107, 2016. <https://doi.org/10.1016/j.cscm.2016.01.004>
- KHORSANDI, H.; MOHAMMADI, A.; KARIMZADEH, S.; KHORSANDI, J. Evaluation of corrosion and scaling potential in rural water distribution network of Urmia, Iran. **Desalination and Water Treatment**, p. 1-8, 2015. <http://dx.doi.org/10.1080/19443994.2015.1042058>
- LIANG, J.; DENG, A.; XIE, R.; GOMEZ, M.; HU, J.; ZHANG, J. et al. Impact of flow rate on corrosion of cast iron and quality of re-mineralized seawater reverse osmosis (SWRO) membrane product water. **Desalination**, v. 322, p. 76-83, 2013. <https://doi.org/10.1016/j.desal.2013.05.001>

- LIU, H.; GU, T.; LV, Y.; ASIF, M.; XIONG, F.; ZHANG, G. et al. Corrosion inhibition and anti-bacterial efficacy of benzalkonium chloride in artificial CO₂-saturated oilfield produced water. **Corrosion Science**, v. 117, p. 24-34, 2017. <http://dx.doi.org/10.1016/j.corsci.2017.01.006>
- MIRZABEYGI, M.; ABBASNIA, A.; YOUZI, H.; ALIKHANI, M.; MAHVI, A. Evaluation of groundwater quality and assessment of scaling potential and corrosiveness of water supply networks, Iran. **Research and Technology—AQUA**, p. 1-10, 2017. <https://doi.org/10.2166/aqua.2017.128>
- OMAKA, O. N.; OFFOR, I. F.; ONWE, I. M. Hydrogeochemical attributes and ground water quality of Ngbo Community in Ohaukwu Area Council, Ebonyi State, Nigeria. **Revista Ambiente & Água**, v. 10, n. 1, p. 35-47, 2015. <http://dx.doi.org/10.4136/ambi-agua.1453>
- PENG, C.; FERGUSON, J.; KORSHIN, G. Effects of chloride, sulfate and natural organic matter (NOM) on the accumulation and release of trace-level inorganic contaminants from corroding iron. **Water Research**, v. 47, n. 14, p. 5257-5269, 2013. <https://doi.org/10.1016/j.watres.2013.06.004>
- SORLINI, S.; BIASIBETTI, M.; ABBÀ, A.; COLLIVIGNARELLI, M. C.; DAMIANI, S. Water Safety Plan for drinking water risk management: the case study of Mortara (Pavia, Italy). **Revista Ambiente & Água**, v. 12, n. 4, p. 513-526, 2017. <http://dx.doi.org/10.4136/ambi-agua.2102>
- TAVANPOUR, N.; NOSHADI, M.; TAVANPOUR, N. Scale Formation and Corrosion of Drinking Water Pipes: A Case Study of Drinking Water Distribution System of Shiraz City. **Modern Applied Science**, v. 10, n. 3, p. 166-177, 2016. <http://dx.doi.org/10.5539/mas.v10n3p166>
- VAZDIRVANIDIS, A.; PANTAZOPOULOS, G.; RIKOS, A. Corrosion investigation of stainless steel water pump components. **Engineering Failure Analysis**, v. 82, p. 466-473, 2016. <https://doi.org/10.1016/j.engfailanal.2016.09.009>
- WANG, Y.; CHENG, G.; WU, W.; QIAO, Q.; LI, Y.; LI, X. Effect of pH and chloride on the micro-mechanism of pitting corrosion for high strength pipeline steel in aerated NaCl solutions. **Applied Surface Science**, v. 349, p. 746-756, 2015. <https://doi.org/10.1016/j.apsusc.2015.05.053>
- YANG, F.; SHI, B.; GU, J.; WANG, D.; YANG, M. Morphological and physicochemical characteristics of iron corrosion scales formed under different water source histories in a drinking water distribution system. **Water Research**, v. 46, n. 16, p. 5423-5433, 2012. <https://doi.org/10.1016/j.watres.2012.07.031>
- YOUSEFI, M.; SALEH, H. N.; MAHVI, A. H.; ALIMOHAMMADI, M.; NABIZADEH, R.; MOHAMMADI, A. A. Data on corrosion and scaling potential of drinking water resources using stability indices in Jolfa, East Azerbaijan, Iran. **Data Brief**, v. 16, p. 724-731, 2018. <https://doi.org/10.1016/j.dib.2017.11.099>
- ZHANG, X.; MI, Z.; WANG, Y.; LIU, S.; NIU, Z.; LU, P. et al. A red water occurrence in drinking water distribution systems caused by changes in water source in Beijing, China: mechanism analysis and control measures. **Frontiers of Environmental Science & Engineering**, v. 8, n. 3, p. 417-426, 2014. <https://doi.org/10.1007/s11783-013-0558-4>