



PROSPECTIVA

ISSN: 1692-8261

rprospectiva@gmail.com

Universidad Autónoma del Caribe

Colombia

García-Ibáñez, Juan; Valencia-Ochoa, Guillermo; Vanegas-Chamorro, Marley  
Design of a mechanical subcooling system device for increasing a low temperature  
refrigeration system's capacity

PROSPECTIVA, vol. 11, núm. 2, julio-diciembre, 2013, pp. 13-20

Universidad Autónoma del Caribe

Available in: <http://www.redalyc.org/articulo.oa?id=496250736002>

- How to cite
- Complete issue
- More information about this article
- Journal's homepage in redalyc.org

redalyc.org

Scientific Information System

Network of Scientific Journals from Latin America, the Caribbean, Spain and Portugal

Non-profit academic project, developed under the open access initiative

# Design of a mechanical subcooling system device for increasing a low temperature refrigeration system's capacity

## Diseño de un dispositivo de subenfriamiento mecánico para aumentar la capacidad de un ciclo de refrigeración de baja temperatura.

Juan García-Ibáñez<sup>1</sup>, Guillermo Valencia-Ochoa<sup>2</sup>, Marley Vanegas-Chamorro<sup>3</sup>

<sup>1</sup> Ingeniero Mecánico, Universidad del Atlántico

<sup>2</sup> Ingeniero Químico, PhD., Profesor Asistente, Universidad del Atlántico

<sup>3</sup> Ingeniero Mecánico, MSc., Profesor Asistente, Universidad del Atlántico  
Grupo Gestión Eficiente de Energía Kai. guillermoevalencia@mail.uniatlantico.edu.co

Recibido 23/10/13, Aceptado 20/12/2013

### ABSTRACT

The mechanical subcooling is employed to increase the coefficient of performance of any refrigeration cycle, especially in low temperature applications. When is necessary to retrofit a cycle, a dedicated mechanical subcooling system allows great flexibility to find one specific operating point such as a retrofitted system with a mayor capacity and better coefficient of performance (COP) or a retrofitted system with the same capacity and less run time required. Simulations run in Aspen HYSYS® using the proper fluid package lets study as many cases needed to get an optimum design for a retrofitted system, taking into account all the restrictions according each component in the main cycle

**Keywords:** Mechanical subcooling, COP, Subcooling temperature, Effectiveness.

### RESUMEN

El subenfriamiento mecánico se emplea para incrementar el coeficiente de desempeño de cualquier ciclo de refrigeración, especialmente en las aplicaciones de baja temperatura. Cuando es necesario reconfigurar un ciclo existente, un dispositivo de subenfriamiento mecánico permite una gran flexibilidad para encontrar un punto específico de operación, ya sea un sistema combinado con un mejor coeficiente de desempeño (COP) y una mayor capacidad de refrigeración o un sistema combinado de la misma capacidad que trabaja por menos tiempo y un mejor COP. Las simulaciones corridas en Aspen HYSYS® permiten estudiar tantos casos posibles como pueden presentarse para lograr un diseño óptimo en el sistema reconfigurado, teniendo en cuenta la restricciones que representan cada uno de los componentes existentes en el sistema principal.

**Palabras clave:** Subenfriamiento mecánico, COP, temperatura de subenfriamiento, efectividad.

## 1. INTRODUCTION

The mechanical subcooling allows increasing the coefficient of performance of any refrigeration system by establishing a specific subcooling temperature, to retrofit a system is necessary to have a complete comprehension about its the operational context and some technical factors which must be taken into account to reach an optimum design.

Thornton et al. [1] found the most important factor is the subcooling temperature, by proposing an ideal tempera-

ture dependent model, which shows the COP's behavior when the subcooling temperature varies between the evaporation and condensation temperature, then with a thermodynamic properties dependent model confirmed the good accuracy of the model.

Khan and Zubair [2,3] developed a model which takes into account all the system's operational characteristics and irreversibility, showing the same behavior found by Thornton et al. [1]. Also simplify the analysis by introducing the effectiveness concept to set the energy balances.

Qureshi and Zubair [4] studied the effect of refrigerant combinations on performance of a vapor compression refrigeration system with dedicated mechanical subcooling and they found R134a has the highest level of performance in this kind of systems.


To find a suitable model to predict the retrofitted cycle's behavior is necessary to establish considerations for the main cycle components. Ding [5] showed a very useful description about the main parameters which have to be taken into account for any component of the refrigeration cycle to develop a right study of the general cycle performance.

Some advantages to provided subcooling to any refrigeration cycle are exposed by Benouali et al. [6] where the study was realized with different subcooling ways, and always the subcooling represent at least capacity increasing.

## 2. METHODOLOGY AND CYCLE DESCRIPTION


The cycle is a refrigeration system which works with R-22 as a refrigerant, evaporating at two temperatures levels, mid temperature [ $0^{\circ}\text{C}$ ] and low temperature [ $-30^{\circ}\text{C}$ ], there are six evaporators for mid temperature and five for low temperature, with a condensation by air process and four ventilators, two compressor racks one for mid temperature and the other one for low temperature as shown in Figure 1.

**Figure 1.**Original cycle configuration.  
**Figura 1.** Configuración original del ciclo.

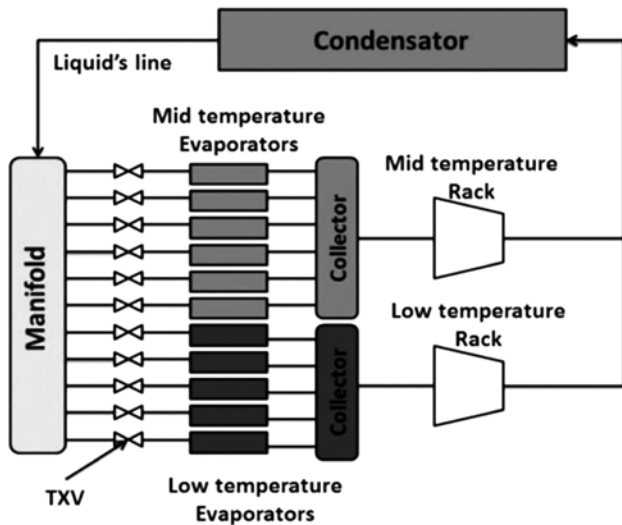


The target is to provide mechanical subcooling to a low temperature system so is necessary modify the current situation by installing two manifold instead of one as shown in Figure 2.

**Figure 2.**Necessary retrofit for the cycle.  
**Figura 2.**Adaptación necesaria para el ciclo.

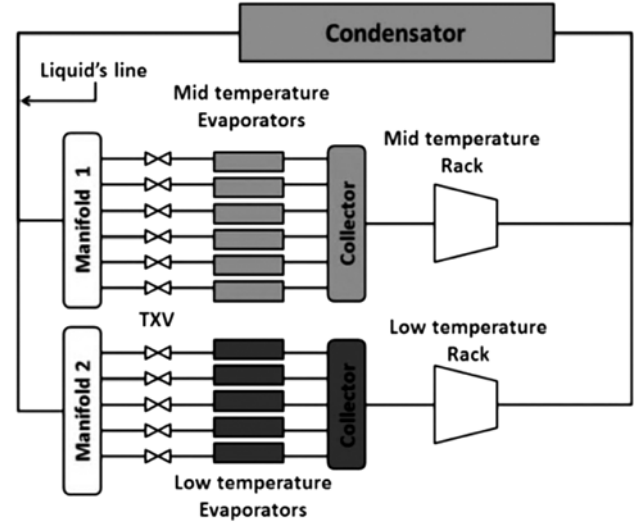

Once the dedicated mechanical subcooling system is installed, the entire system will have the configuration shown in the Figure 3.

**Figure 3.** Main cycle with dedicated mechanical subcooling.  
**Figura 3.** Ciclo principal con subenfriamiento mecánico dedicado.

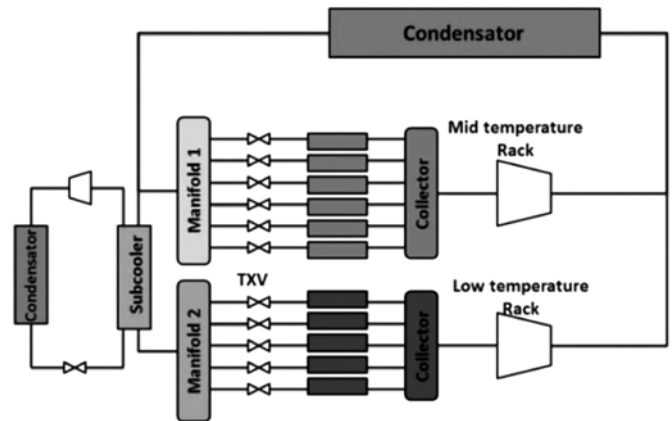

Taking into account that temperature and pressure are intensive properties is possible to simplify the cycle and treat it as a single low temperature refrigeration system with dedicated mechanical subcooling system represented as shown in Figure 4.

The operational conditions for the equivalent low temperature refrigeration cycle such as the average surrounding temperature ( $T_{\text{surd}}$ ), the set point of the evaporator temperature ( $T_{\text{target}}$ ), the motor electrical efficient ( $\eta_{\text{electrical}}$ ) and the compressor mechanical efficient ( $\eta_{\text{mechanical}}$ ), the discharge

pressure ( $P_{\text{discharge}}$ ) and suction pressure ( $P_{\text{suction}}$ ) and the compressor operation factor ( $F_{\text{op}}$ ), are summarized in Table 1, which were reported for the maintenance department of a supermarket located in Barranquilla-Colombia.

Figure 4. Simplified cycle.  
Figura 4. Ciclo simplificado.

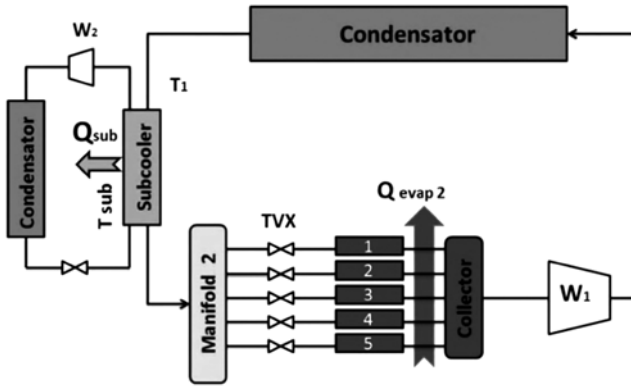


Table 1. Operational parameters  
Tabla 1. Parámetros operacionales

Operational parameters			
$T_{\text{surd}}$	$T_{\text{target}}$	$\eta_{\text{electrical}}$	$\eta_{\text{mechanical}}$
35°C	-30°C	0.9	0.8
$P_{\text{discharge}}$	$P_{\text{suction}}$	Refrigerant	FOP
15.5 bar	0.1 bar	R-22	0.85
Refrigeration Capacity		38 kW	
Compressors work		kW	

### 3. RESULT AND DISCUSSION

#### 3.1. Temperature Dependet Model

The temperature dependent model proposed by Thornton et al. [1], express thecoefficient of performance of the cycle with subcooling ( $COP_{\text{cws}}$ ) depends mainly from the subcooling temperature and the subcooler's effectivenessas follow:

$$COP_{\text{cws}} = \frac{\dot{Q}_{\text{evap1}} + \varepsilon(\dot{m}C_p)_{\text{min}}(T_1 - T_{\text{sub}})}{W_1 + \frac{\varepsilon(\dot{m}C_p)_{\text{min}}(T_1 - T_{\text{sub}})^2}{T_{\text{sub}}}}, \quad (1)$$

where:

$COP_{\text{cws}}$  is the coefficient of performance of the cycle with subcooling.

$\dot{Q}_{\text{evap1}}$  is the initial refrigeration capacity of the cycle.

$\varepsilon$  is the subcooler effectiveness.

$T_{\text{sub}}$  is the subcooling temperature.

$T_1$  is the subcooler inlet refrigerant temperature in the main cycle.

$\dot{m}C_p$  is the heat capacity rate of cold fluid.

$W_1$  is the initial compressor energy consumption.


Only  $T_{\text{sub}}$  and  $\varepsilon$  are unknown parameters but  $\varepsilon$  remains constant once the subcooler heat exchanger is chosen; attending to the above consideration is possible to study the  $COP_{\text{cws}}$ 's behavior when the  $T_{\text{sub}}$  varies while keeping  $\varepsilon$  constant.

#### 3.2 System's behaviour according to the temperature dependent model

Is important to remark the  $COP_{\text{cws}}$ 's tendency do not depend from  $\varepsilon$  as can be observed in Figure 5, it means, the effect of  $\varepsilon$  is to move the  $COP_{\text{cws}}$  profile. Higher  $\varepsilon$  values means higher  $COP_{\text{cws}}$  values at a same subcooling temperature but it shows the same behavior despite the  $\varepsilon$  value.

Figure 5.  $Cop_{\text{cws}}$  as a function of  $T_{\text{sub}}$  in the ideal model.

Figura 5.  $COP_{\text{cws}}$  como función de la  $T_{\text{sub}}$  en el modelo ideal.

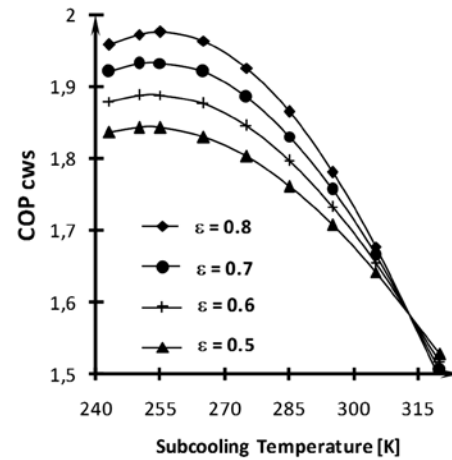


#### 3.3 Original cycle run in Aspen HYSYS®.

In order to support the results obtained by the temperature dependent model the simplified cycle was run in Aspen HYSYS®, according to components shown in Figure 6.

Figure 6. Equivalent cycle.

Figura 6. Ciclo equivalente.

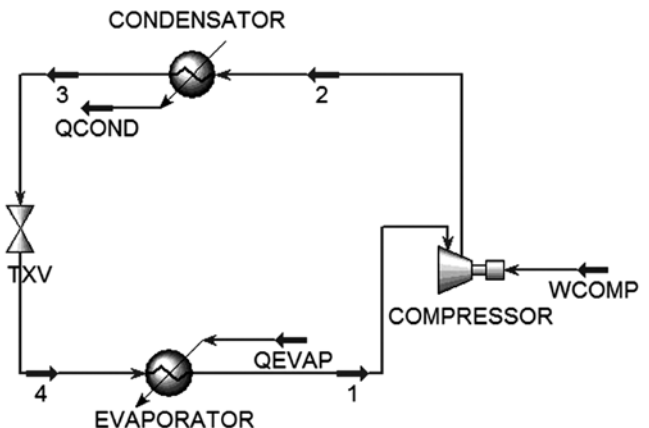

The Table 2 presents the thermodynamic state in the cycle based on the information recovered from the process, assuming saturated vapor at inlet compressor, an adiabatic and polytropic coefficient of 75% and 79.13% respectively, the mass flow rate was calculated assisted by the software in order to have the power compressor installed on the equipment.

**Table 2.** Thermodynamic State of the cycle.  
**Tabla 2.** Estado Termodinámico del ciclo.


Properties				
Flow	1	4	3	4
Pressure[kPa]	130	1596	1548	164
Temperature[K]	243.1	392,6	313.1	243.1
Mass Flow[kg/h]	968	968	968	968
Vapor Fraction	1	1	0	0,360
COP <sub>0</sub>	1,5860			

The cycle was simulated in Aspen HYSYS® using the Peng-Robinson model as Property Packages due to this model have a large applicability range in terms of temperature and pressure, and it was found a COP value of 1.586 while the subcooling temperature is 312 K, which is closed in meaning with the behavior of COP<sub>cws</sub> in Figure 5. Based on the fairly good agreement between the simulation and real behavior on the process, a system's performance study is developed when a dedicated mechanical subcooling is provided using different refrigerants.

### 3.4. Dedicated mechanical subcooling cycle with three different refrigerants

The low temperature refrigeration cycle with a dedicated mechanical subcooling system was modeled using Aspen HYSYS® for three different refrigerants on the subcooler cycle. Figure 7 shown a simplified representation of the system as follow:

**Figure 7.** Simplified cycle with subcooling.  
**Figura 7.** Ciclo simplificado con subenfriamiento.

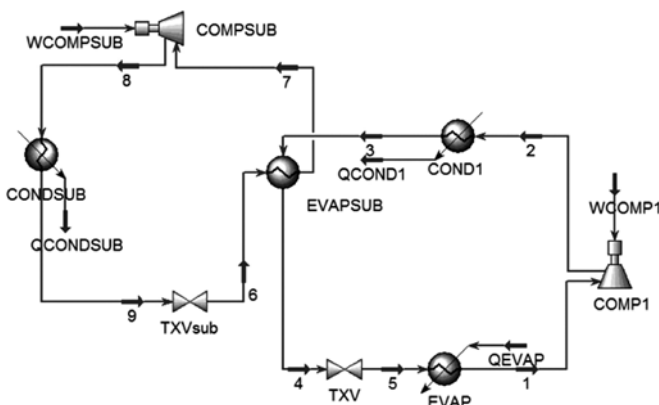

Based on Figure 7, an energy balance is applied to all the cycle, in order to calculate input and output energy transfer. To calculate de COP<sub>cws</sub> a very simple equation is used, this equation takes into account the energy consumption of both compressors and the new system refrigeration capacity, which is the heat transfer removed on the evaporator.

$$COP_{cws} = \frac{\dot{Q}_{evap2}}{\dot{W}_2} = \frac{\dot{Q}_{evap1} + \dot{Q}_{sub}}{\dot{W}_1 + \dot{W}_{sub}}, \quad (2)$$

where:


- $COP_{cws}$  is the coefficient of performance of the cycle with subcooling.
- $\dot{Q}_{evap1}$  is the initial refrigeration capacity of the cycle.
- $\dot{Q}_{evap2}$  is the refrigeration capacity of the cycle including subcooling.
- $\dot{Q}_{sub}$  is the heat transfer rate on subcooler heat exchanger
- $\dot{W}_1$  is the initial compressor energy consumption.
- $\dot{W}_{sub}$  is the compressor energy consumption on the auxiliary cycle.

Figure 8 shown the COP<sub>cws</sub>'s behavior while T<sub>sub</sub> changes for using two alternative refrigerants: R134a, R404a. These are replacements for refrigerants, e.g. R12 that harm the ozone layer and are part of the increasing worry about their global warming potential due to the greenhouse effect as seen in Kyoto Protocol [7].

Even though these alternative fluids are harmless to the ozone layer, they can contribute to global warming because of leaks but more so, in an indirect way, through energetic performance of the refrigeration cycle according to Calm [8] and Sand et al. [9].

**Figure 8.** Cop<sub>cws</sub> as a function of T<sub>sub</sub> for R-404a, R-134a and R-22 on the auxiliary cycle.

**Figura 8.** Cop<sub>cws</sub> como una función de T<sub>sub</sub> para R-404a, R-134a y R-22 en el ciclo auxiliar.

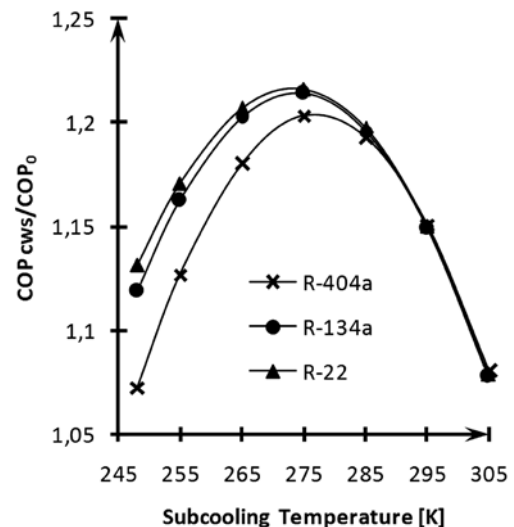




This graphic was developed with  $\varepsilon=0.9$ , because of a lower subcooler effectiveness the  $COP_{cws}$  profile for the refrigerants are superimposed in a long temperature range. Figure 9 shows the same tendency as the temperature dependent but the maximum values are displaced to the right as a consequence of the heat transfer and mass flow irreversibilities on the subcooler and the different refrigerant properties, the maximum value reached was  $COP_{cws}$  1.928 at 275 K with R-22. Another way to show the benefits of the mechanical subcooling is comparing the  $COP_{cws}$  and the initial  $COP_0$  for the different refrigerant while  $\varepsilon = 0.9$  as shown in Figure 9.

**Figure 9.**  $COP_{cws}/COP_0$  ratio as a function of  $T_{sub}$ .

**Figura 9.** Relación  $COP_{cws}/COP_0$  como una función de la  $T_{sub}$ .

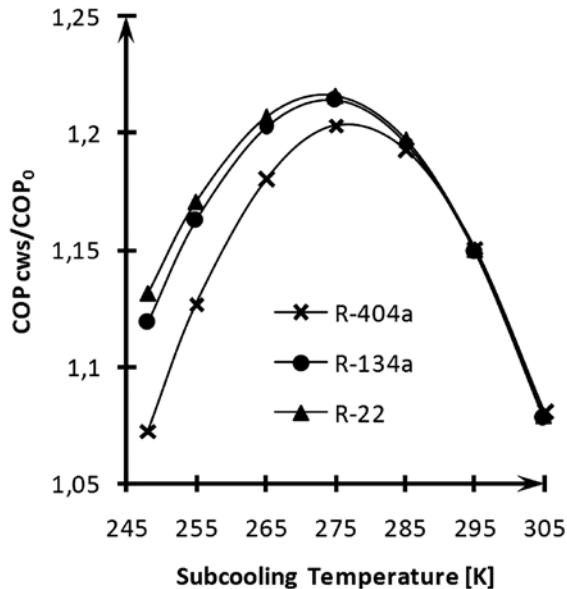


In this case is very easy to see the improvement because the vertical axis shows how much the  $COP_{cws}$  increase with respect to  $COP_0$ . In Figure 9a value of 1,2 means an improvement of 20% in the coefficient of performance, also it can be seen the R-22 and R-134a performances are almost equal, for that reason and taking into account that R 134a is less harmful to the environment Schwarz[10], this was chosen as working fluid in the dedicated mechanical subcooling cycle.

### 3.5 System performance with R-134a as refrigerant in the dedicated cycle.

Chosen R-134a as the dedicated mechanical subcooling system refrigerant, the performance for three different values of  $\varepsilon$  was studied as shown in Figure 10.

**Figure 10.**  $COP_{cws}$  as function of  $T_{sub}$  with R-134a as refrigerant on the auxiliar cycle.


**Figura 10.**  $COP_{cws}$  en función de  $T_{sub}$  con R-134a como refrigerante en el ciclo auxiliar.

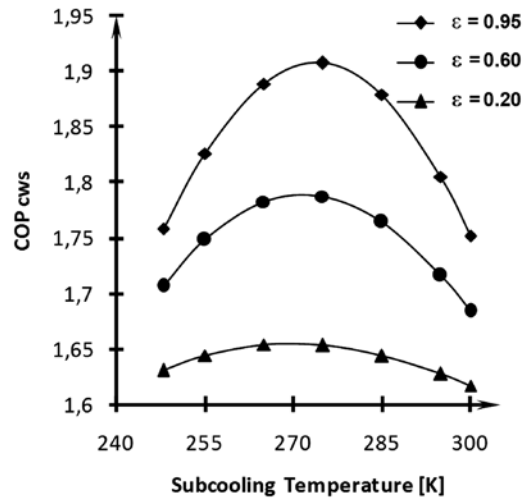

This figure remarks how important is the  $\varepsilon$  value to get a technical and economic viability for the dedicated mechanical subcooling system, due to the subcooling heat exchanger cost depend of  $\varepsilon$  value, but is not enough to choose a heat exchanger with a high  $\varepsilon$  because of is also important provide the right mass flow in order to exchange as much heat as the  $\varepsilon$  value allows, according to results presented in Figure 11, when the  $COP_{cws}$ 's and the mass flow behavior depends of the outlet refrigerant temperature from the subcooler heat exchanger (liquid line temperature) at the primary cycle side change from 273 K to 313 K, once a  $T_{sub}$  and  $\varepsilon$  have been stated.

**Figure 11.** Effectiveness and mass flow as function as liquid line temperature.

**Figura 11.** Eficacia y flujo másico en función de la temperatura de línea líquida.

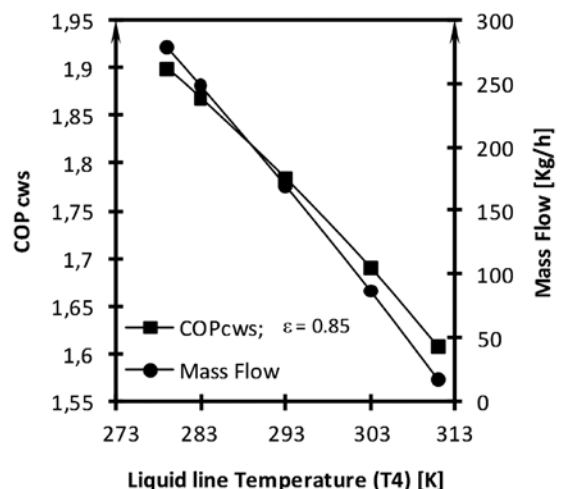

It can be seen that a good  $\varepsilon$  value is really important when it work with the proper refrigerant's mass flow, even the electric work consumed by the compressor is proportional to the mass flow Cengel and Boles [11], the overall performance depends on the liquid line temperature after the subcooler, increasing this temperature, reaches the limits that affect the cycle operating conditions, which leads to decrease its coefficient of performance and as a result its cooling capacity as shown in Figure 11. In addition, a higher liquid line temperature increase the electrical power consumption, making it necessary to improve the performance of these equipments under the new design working conditions. The optimal subcooling temperature for this cycle is 275K, however the goal is to increase the system capacity; this is limited by the evaporators' nominal capacity, the Table 3 shows the evaporators' capacities.

**Table 3.** Refrigerating capacities per line.

**Table 3.** Capacidades de refrigeración por línea.

Lines	Capacity Btu/h
Line 7	34800
Line 8	34800
Line 9	14530
Line10	13430
Line11	32234
Total Btu/h	129811
Total kW/h	38.05


It was remarked that all the evaporators could be study as one main evaporator since temperature and pressure are intensive properties, so this cycle can be study a traditional cycle with just one evaporator of 40 kW nominal capacity. As a technical fact every heat exchanger is able to work properly in a rage of +/- 15% of the nominal capacity, which is 6 kW, so that the maximum capacity that is possible to reach by mechanical subcooling by maintaining the same components in the main cycle is 46 kW.

It is possible to increase the current capacity 20%, which is 7.61 kW for a total of 45.65 kW, this value set immediately the subcooler's cooling capacity. A simulation of the cycle was developed with an increase of 20% through a dedicated mechanical subcooling system at 275K, as shown in Figure 12.

Once the simulation was developed taking into account all the thermodynamic condition, the drops pressures and the energy duty on the systems were calculated obtaining the Table 4.

**Figure 12.** Simplified cycle with subcooling simulation at optimal subcooling temperature.

**Figura 12.** Simulación del ciclo simplificado a la temperatura óptima de subenfriamiento.

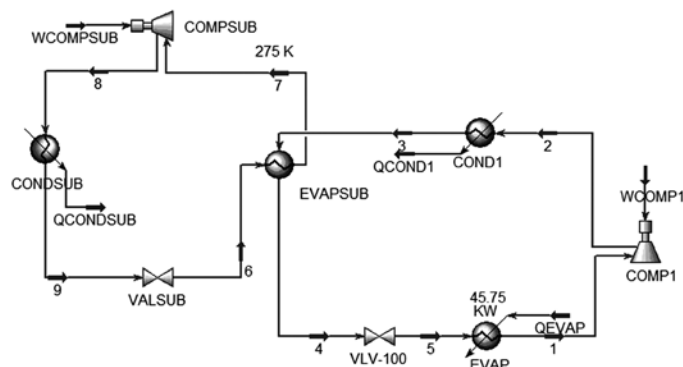**Table 4.** Exchagers' main features

**Tabla 4.** Principales características de los intercambiadores.

Exchanger	Evap	Cond1	Condsb	Evapsb
Capacity [kW]	45.75	60.97	10	7.65
Drop pressure [kPa]	34,47	48,26	13,78	0

The compressor' parameters of the simplified cycle are presented in Table 5. It presents the values of power, adiabatic efficiency, polytropic efficiency, change of temperature and pressure, as you can see the compressor number one has greater polytropic efficiency than the subcooling compressor for the optimal operational condition of the overall cycle, information used to select the component for the auxiliary cycle.

Table 5. Compressors' parameters

**Tabla 5.** Parámetros de los compresores

	Compressor 1	Compressor subcooling
Power [kW]	23,57	1,63
Adiabatic Efficiency	75%	75%
Polytropic Efficiency	79,13%	76,56%
Delta T [K]	134,917	43,49
Delta P [kPa]	1429,28	597,09

### 3.6. Components selection

All the operational parameters required for any component to achieve the best System's performance are named in Table 6, this information is completely necessary when a component must be chosen.

### 3.6.1. Subcooler evaporator's selection.

GEAFlatplate SELECT™ ONLINE is an informatics application available in internet used to select heat exchanger, allowing user define the operational condition, then the model of the equipment and finally get technical specification useful tool to find the most suitable plate exchanger the following information is required. [12]

Is an internet based Heat Exchanger Selection Program for use by FlatPlate customers on a routine basis. It is an advanced program allowing users to input application design conditions, and then select the appropriate heat exchanger model, including print-outs and drawings.

**Table 6.** Evaporator and liquid side operational parameter.  
**Tabla 6.** Parámetros operacionales evaporador y lado de líquido.

Side A-EVAPORATOR		Side B – LIQUID REFRIGERANT	
Refrigerant	R 134 a	Refrigerant	R-22 liquid
Evaporation temperature (°C)	2	Entering liquid temperature (°C)	40
Superheat (°C)	4	Out liquid temperature (°C)	16
Liquid temperature entering to thermostatic expansion valve(TXV) (°C)	5	Mass flow (kg/h)	950

### 3.6.2. Condensator and compressor selection.

To simplify the installation of a dedicated mechanical sub-cooling system a condensing unit is recommended to keep the dedicated cycle as small as possible, for this process a software provided by Emerson Climate Technologies[13] was employed. The Table 7 presents all the parameter that must be taken into account for selecting a condensing unit.

**Table 7.** Compresor's parameters.  
**Tabla 7.** Parámetros del compresor.

REQUIRED PARAMETERS TO SELECT	
Refrigerant	134 a
Frequency (Hz)	60
Type of condensation	By air
Application temperature	High/medium
Environment temperature (°C)	35
Evaporation temperature (°C)	2
Condensator duty (W)	10.200

### 3.6.3 Thermostatic expansion valve selection

The TXV which is the component in the cycle that regulate the amount of refrigerant flow into the evaporator heat exchanger, in this manner controlling the superheating at the outlet of the evaporator. The parameters used to select the TXV are showed in Table 8 using the Thermostatic expansion valves catalogue provided by Danfoss[14].

**Table 8.** Thermostatic expansion valve's parameters.  
**Tabla 8.** Parámetros de la válvula de expansión termostática.

THERMOSTATIC EXPANSION VALVE	
Refrigerant	R-234 a
Evaporator duty	8 KW
Evaporation pressure	3.10 bar
Condensation pressure	10 bar
Subcooling	5 °C
Drop pressure through the TXV	5.3 bar

The simulations was run when all the components' features were input in the model and was possible to estimate an expected  $COP_{cws}$  for the whole system, working in the conditions the commercial components set.

The operational parameter as well as the  $COP_{cws}$  was estimated by the simulation, according the thermodynamic states of the subcooler and main cycle, defined by specifying a set of measurable properties sufficient such as the temperature and pressure shown in Tables 9.

**Table 9.** State properties in the main subcooler cycle.  
**Tabla 9.** Propiedades de estado en el ciclo principal y ciclo subenfriado.

MAIN CYCLE						SUBCOOLER CYCLE			
Flow	1	2	3	4	5	6	7	8	9
Pressure [kPa]	132,13	1596	1547	1392	166	483,1	317,1	1000,1	1000
Temperature [°C]	-30	118,7	40	16,4	-30	14,3	2	49,43	35
Mass Flow[kg/h]	950	950	950	950	950	198,6	198,6	198,6	198,6
Vapor fraction	1	1	0	0	0,23	0,166	1	1	0

Based on the above thermodynamics properties the new overall performance was calculated, obtaining a  $COP_{cws}$  of 1.8125, which is higher than the initial coefficient of performance for the main cycle. For this reason, the energy consumption can be reduced by incorporating a dedicated mechanical sub-cooling loop to the existing refrigeration systems. Finally, it is important to highlight that, for a given system capacity, the total maintenance cost for a dedicated mechanical sub-cooling system will reduce because



the systems' head pressure will always be lower than the conventional cycle according to Qureshi and Zubair [4]. The conclusions of this study is close with Trott and Welch [15] study, where two possible situations are considered when a dedicated mechanical sub-cooling system is applied: developed a complete design or retrofitting the existing system, using the R134a as working fluid, which is a common substitute for R12 and R22 when the cycle operates at high-temperature level to improve the general coefficient of performance.

#### 4. CONCLUSIONS

- A dedicated mechanical subcooling device will increase the original cycle refrigeration capacity and with the proper subcooling temperature also the overall system's COP will be improved. The COP<sub>cws</sub>'s behavior does not depend on the refrigerant's properties because all of them showed the same tendency, but some refrigerants allow to reach higher values of COP<sub>cws</sub>, as R-22 and R-134a, despite R-22 reaches the higher values, R-134a is more friendly with the environment and its performance curve is almost the same as R-22. It is important to remark that the three refrigerants have the same performance when the subcooling temperature is more than 285K, the increase of the main cycle capacity is limited by the evaporator nominal capacity, the components to build the dedicated mechanical subcooling device are available and very easy to find with the required operational parameters, these will allow to increase the system capacity in a 20% and the COP<sub>cws</sub> in 14% from the original values.

#### REFERENCIAS

- [1] Thornton, J.W., Klein, S.A., and Mitchell, J.W. Dedicated mechanical subcooling design strategies for supermarket applications. *Int. J. Refrig.*, 17(8), 508- 515, 1994.
- [2] Khan, J.R. and Zubair, S.M. Design and rating of dedicated mechanical subcooling vapour-compression system. *Proc. Inst. Mech. Eng.*, 214, 455-471, 2000.
- [3] Khan, J.-ur-R. and Zubair, S.M. Design and rating of an integrated mechanical-subcooling vapor-compression refrigeration system. *Energy Convers. Manage.*, 41, 1201-1222, 2000.
- [4] Qureshi, B.A. and Zubair, S.M. The effect of refrigerant combinations on performance of a vapor compression refrigeration system with dedicated mechanical sub-cooling. *Int. J. Refrig.*, 35, 47-57, 2012.
- [5] Ding, G.L. Recent developments in simulation techniques for vapour-compression refrigeration systems. *Int. J. Refrig.*, 30, 1119-1133, 2007.
- [6] Benouali, J., Young, S. and Clodic, D. Analysis of the sub-cooling on refrigerating systems using R-410A OR R-404A. Eighth International Refrigeration Conference, Purdue University, West Lafayette, USA, 2000.
- [7] Kyoto Protocol, Report of the Conference of the Parties. United Nations Framework Convention on Climate Change (UNFCCC) Kyoto, Japan, 1997.
- [8] Calm, J.M. Emissions and environmental impacts from air conditioning and refrigeration systems. *Int. J. Refrig.* 25, 293-305, 2002.
- [9] Sand, J.R., Fischer, S.K., and Baxter, V.D., TEWI analysis: its utility, its shortcomings, and its results. In: *International Conference on Atmospheric Protection-Taipei, Taiwan*. 1999.
- [10] Schwarz, W. Emission of Refrigerant R-134a from Mobile Air- Conditioning Systems. Study conducted for the German Federal Environment Office, (Internet). Disponible desde: <http://www.umweltbundesamt.de/sites/default/files/medien/publikation/long/3110.pdf>, [Access 15 October 2013].
- [11] Cengel, Y. A. and Boles, M. A. *Thermodynamics: an engineering approach*, 7th edn. McGraw-Hill, New York, 2011.
- [12] GEA FlatPlate SELECT™- ONLINE. (Internet) On line from: <http://flatplateselect.com/site/hx/chooseapp.aspx> . [Access January 7th 2013].
- [13] Emerson Climate Technologies. (Internet) On line from: [http://www.emersonclimate.com/enUS/products/condensing\\_units/Pages/condensing\\_units.aspx](http://www.emersonclimate.com/enUS/products/condensing_units/Pages/condensing_units.aspx). [Access January 7th 2013].
- [14] Danfoss. (2010). Technical brochure, Thermostatic expansion valves TUA/TUAE. (Internet). On line from: <http://www.ra.danfoss.com/TechnicalInfo/Literature/Manuals/01/DKRCCPDAG0A302.pdf>. [Access October 17th 2013].
- [15] Trott, A.R., Welch, T.C. *Refrigeration and Air-Conditioning*, third ed. Butterworth-Heinemann, UK, 2000.